

# Water Supply Dashboard Update


Nicholas J. Winkelmann, P.E.

Chief Operations Officer – Corpus Christi Water

June 23, 2026



# Western Reservoir Storage

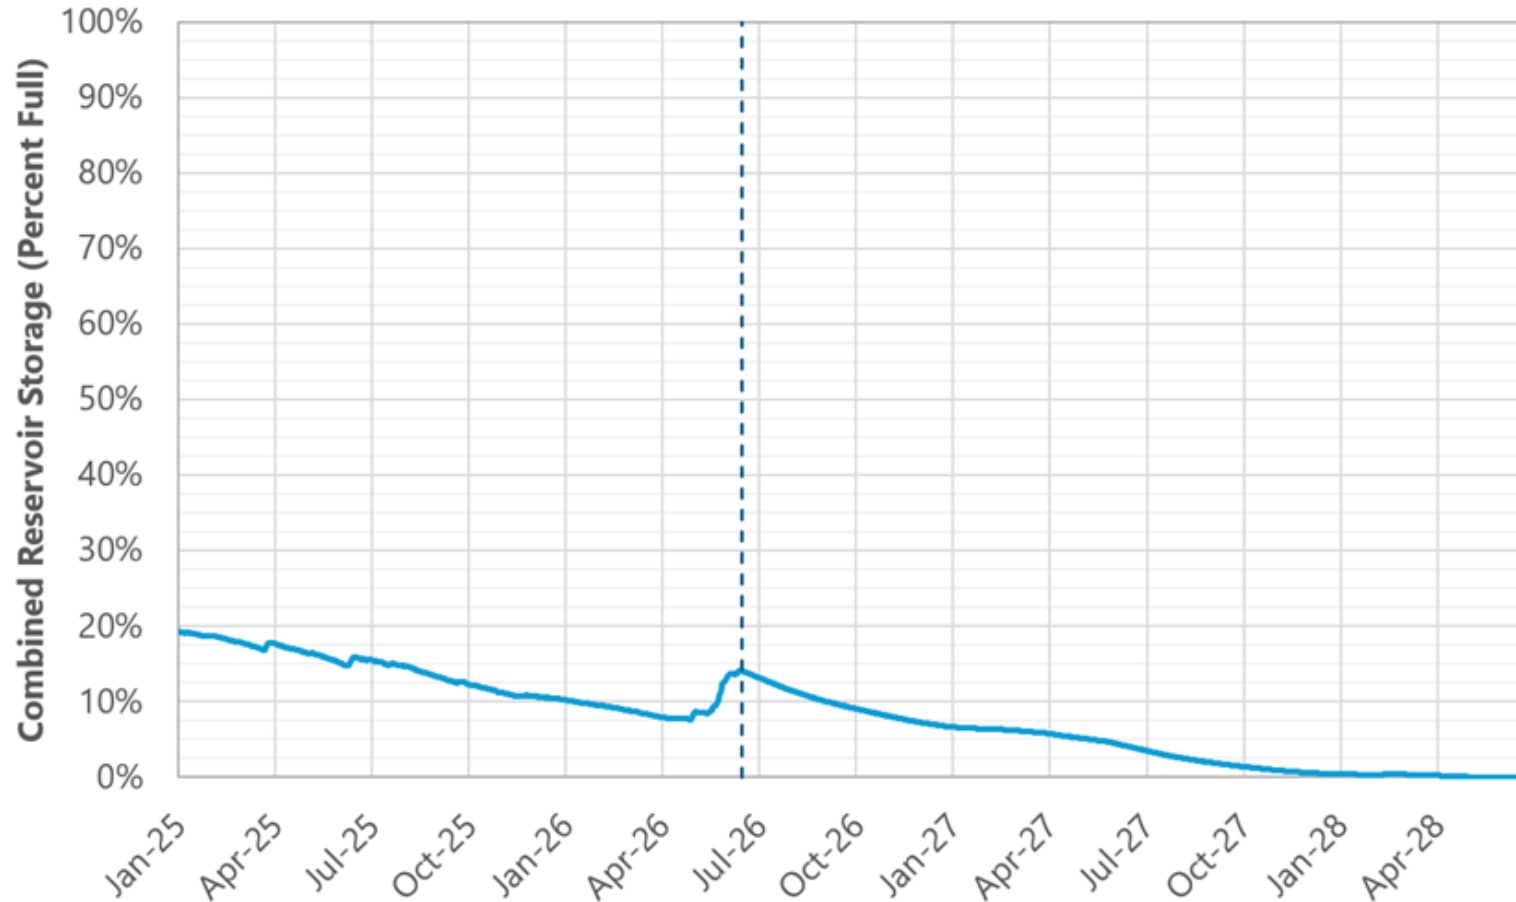

## Combined Capacity (2022 to 2025)

|               |     |
|---------------|-----|
| March 2022    | 50% |
| July 2023     | 40% |
| March 2024    | 30% |
| December 2025 | 20% |


# Water Supply Dashboard

## Inputs & Assumptions

- **Western Reservoirs**
  - Inflows as of June 18, 2026, were utilized
  - Projected stream inflows are estimated at a total of 10,438 acre-feet for the remainder of 2026
- **Nueces Groundwater Program** continues to operate per the protocols established in the Bed and Banks permit
- **Effluent** reuse to offset demand begins December 2026, with amounts increasing through 2027
- **LNRA Curtailment of Lake Texana** is projected be 20% estimated in May 2027
- **Alice, Mathis, and Beeville** demand reduction due to new water supply projects
- **Mary Rhodes Pipeline**
  - Will operate at Schedule 3 (55 MGD) for four weeks to accommodate upgrades at the Woodsboro pump station
  - Will operate at Schedule 2 (43 MGD) for three weeks to accommodate upgrades at the Bloomington pump station

# Water Supply Dashboard

## Updated June 23, 2026

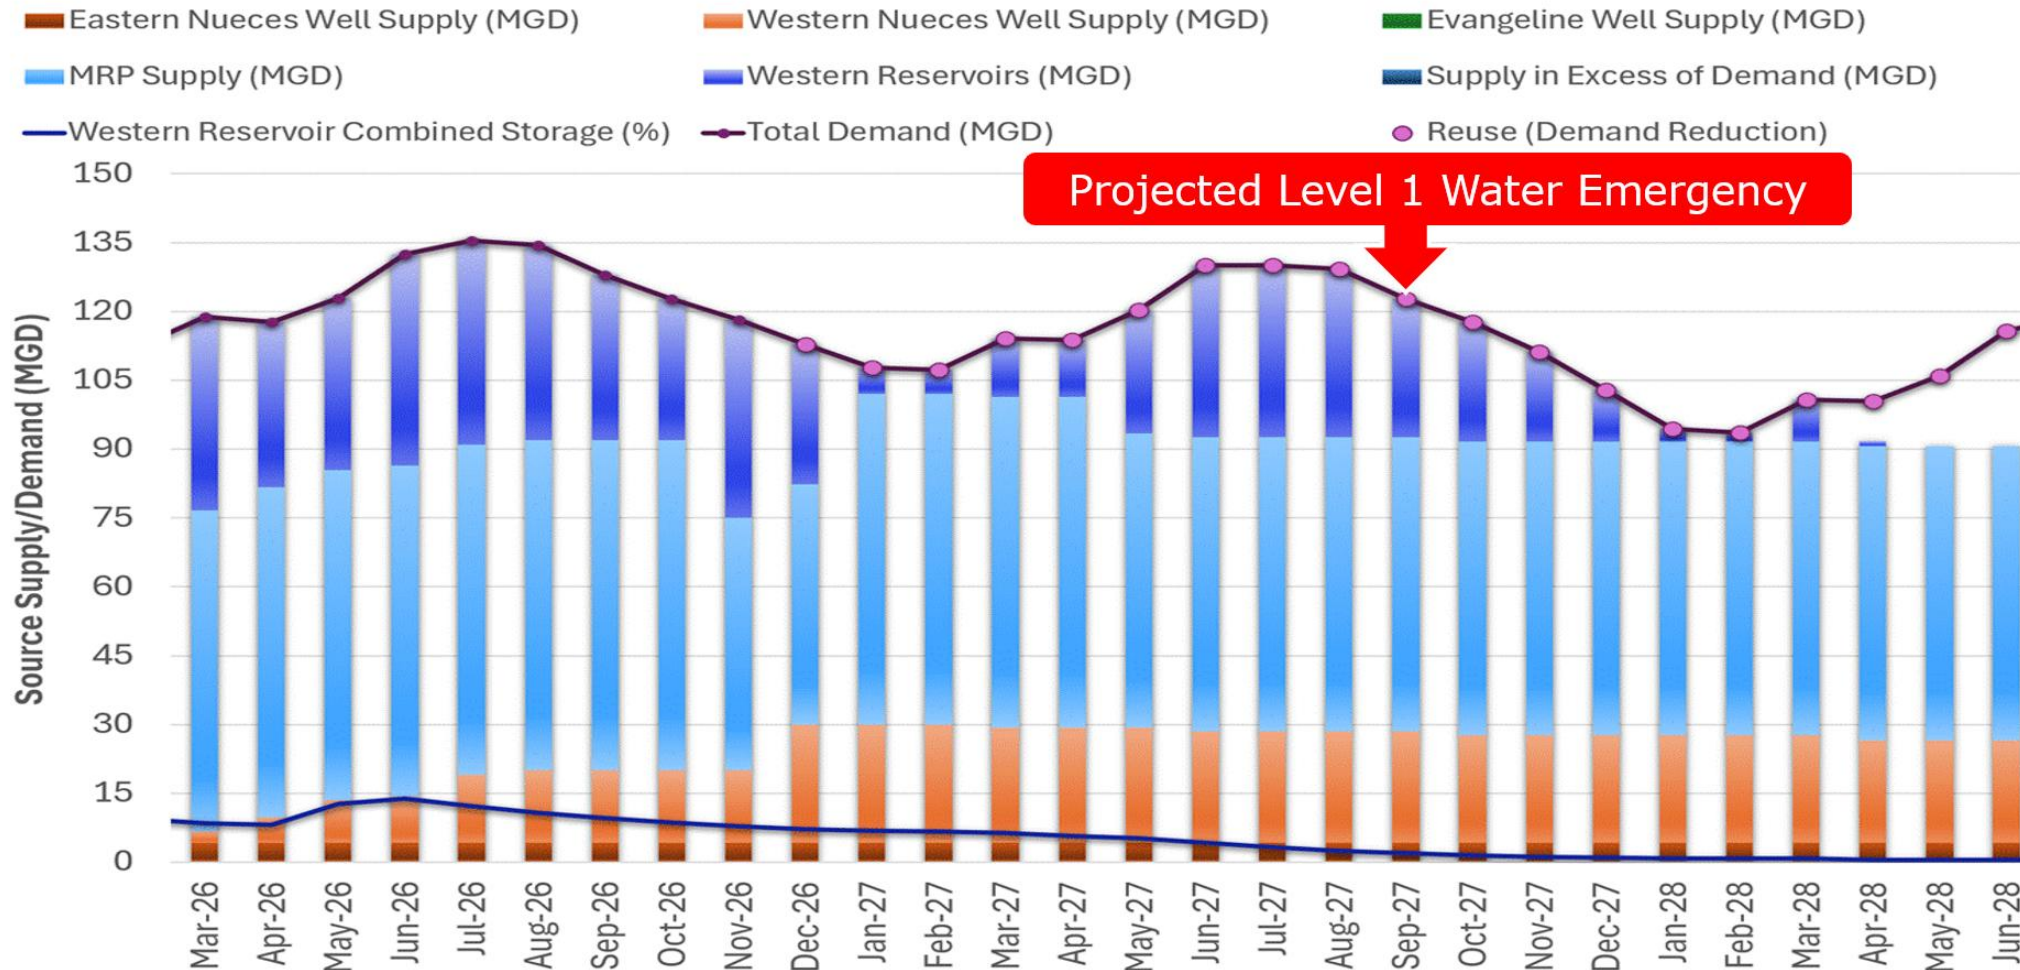

# Level 1 Water Emergency

The estimated date for Level 1 Water Emergency when we are projected to be 6 months away from supply not meeting demand has been updated to September 2027.

